

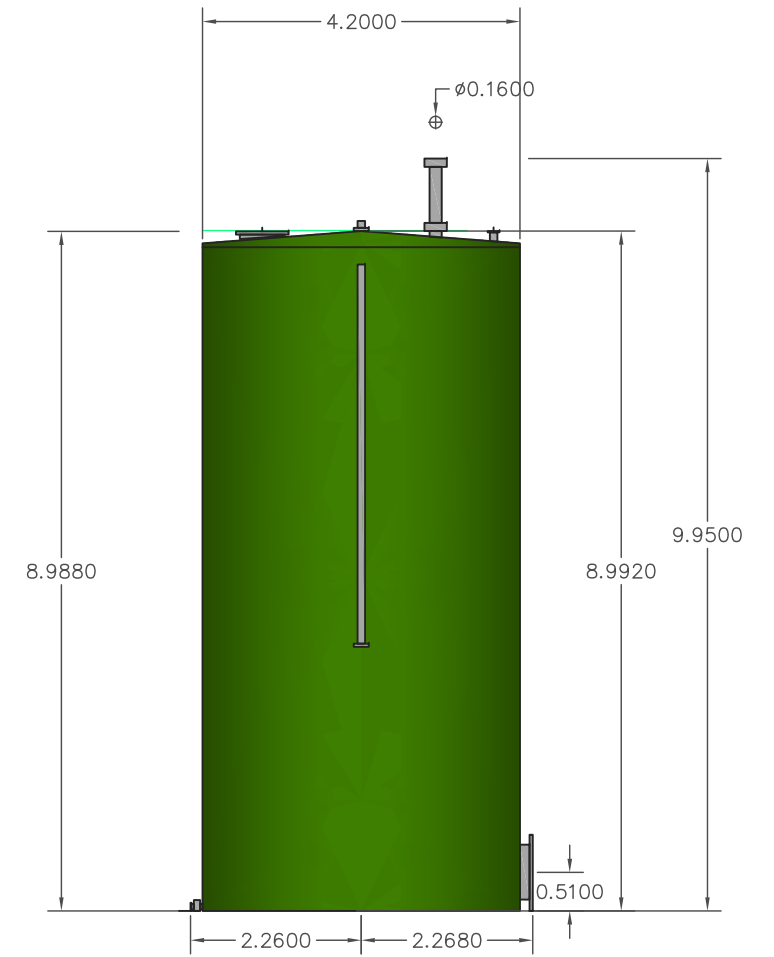
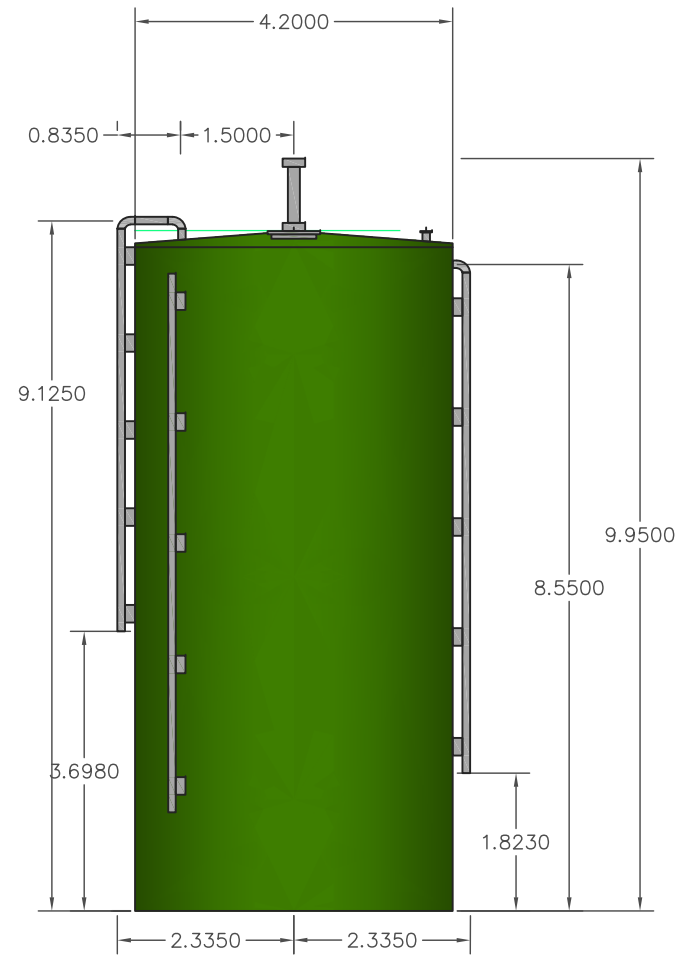



ELEVATIONS OF FIRE WATER STORAGE TANK

All dimensions to be verified on site. Figured dimensions take precedence to those scaled. Any areas indicated on this drawing are for guidance only, no responsibility is taken for their accuracy.
 The drawing is the property of GP Planning Limited. Copyright is reserved by them and the drawing is issued on the condition that it is not copied, reproduced, retained or disclosed to any unauthorised person, either wholly or in part without the written consent in writing of GP Planning.
 © 2022 GP Planning Limited. All rights reserved.

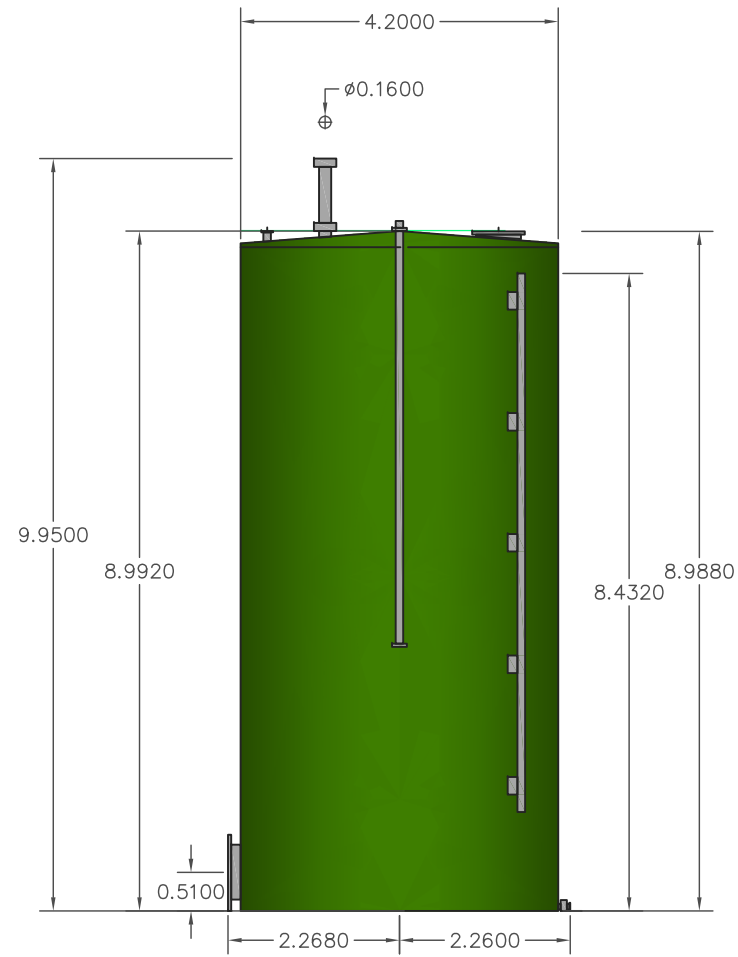

TANK CONNECTION LIST		
CONN. No	SIZE	TYPE
1	DN80	LEVEL PROBE
2	DN100	OVERFLOW
3	DN100	ULTRASONIC
4	DN80	DRAIN
5	DN80	OUTLET
6	600mm	MANWAY
7	DN50	CABLE CONTAINMENT
8	DN100	FILL LINE
9	-	VENT
10	600mm	MANWAY

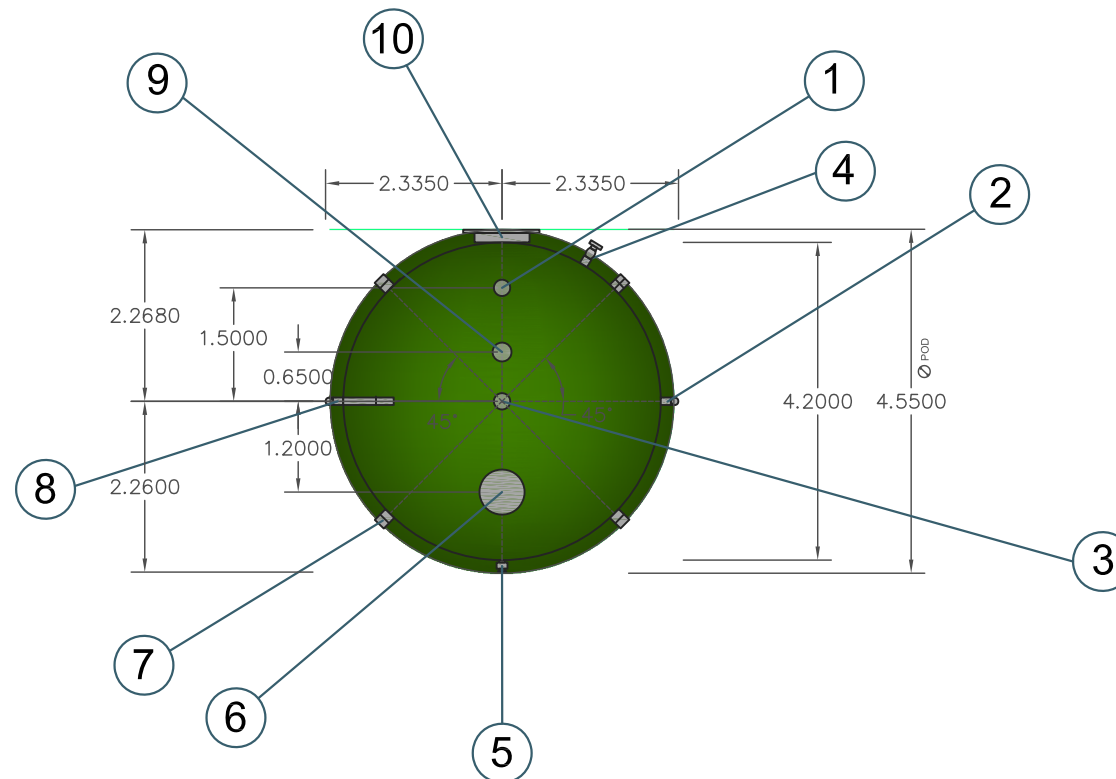

Rev	Description	Initial	Date
 Planning Consultants T: 01604 771123 E: info@gppanning.co.uk W: www.gppanning.co.uk ICon Environmental Innovation Centre, Eastern Way, Doveney, Northamptonshire, NN11 0GS Registered in England No. 6019666			
TITLE:		Proposed Compost Pad at Brockhall Estate, Hill Farm, Rothersthorpe Elevations of Fire Water Storage Tank	
CLIENT:		H COLLINS & SON	
<small>Ordnance Survey Licence; Reproduction from the Ordnance Survey Map with sanction of the Controller of Her Majesty's Stationery Office © Crown Copyright. Licence number 51206561. For identification purposes only.</small>			
DRAWN BY:	KD	CHECKED BY:	CS
DRAWING NO.:	GPP/HC/R/CP/22/07	REV NO.:	0
SCALE:	1:100 at A3	DATE:	27 Apr 2022
SCALE BAR:	